

WATT'S NEW AT HUTT ELECTRIC

"We're here to help you help your customers"


Welcome to our 192nd
edition of our newsletter!

November 2010

This newsletter will provide you, our customers, with information on new technologies, products, discontinuations, etc. in the electrical industry. It will also provide you with information on any projected price increases, price decreases, and any 'special buys' at Hutt Electric Supply.

NEC Code Questions and Answers.....

Q. What are the requirements when replacing 2-wire receptacles?

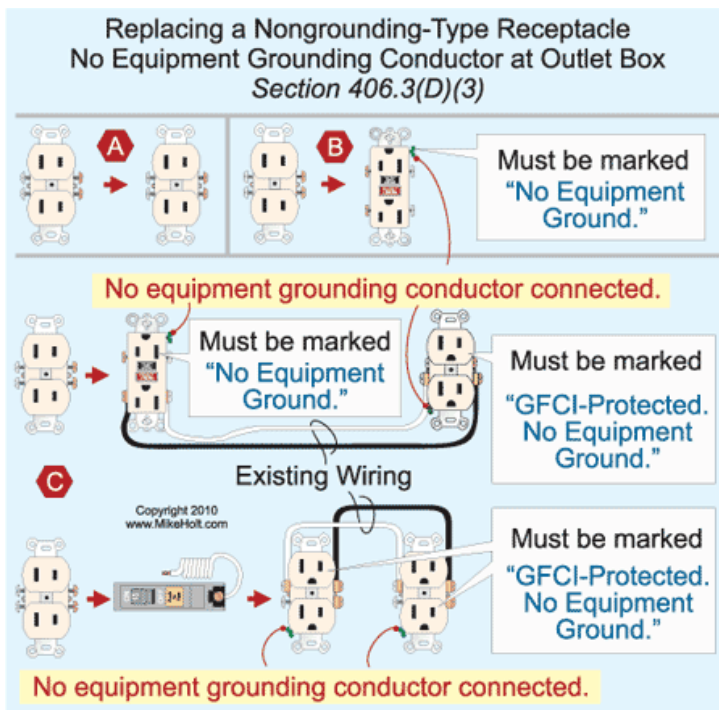

A. The requirements are contained in 406.3(D)(3). Where no equipment grounding conductor exists in the outlet box for the receptacle, such as old 2-wire Type NM cable without an equipment grounding conductor, existing non-grounding type receptacles can be replaced in accordance with (a), (b), or (c):

- (a) Another nongrounding-type receptacle.
- (b) A GFCI-type receptacle marked "No Equipment Ground."
- (c) A grounding-type receptacle, if GFCI protected and marked "GFCI Protected" and "No Equipment Ground."

GFCI protection functions properly on a 2-wire circuit without an equipment grounding conductor because the circuit equipment grounding conductor serves no role in the operation of the GFCI-protection device. See the definition of "Ground-Fault Circuit Interrupter" for more information.

Caution: The permission to replace nongrounding-type receptacles with GFCI-protected grounding-type receptacles doesn't apply to new receptacle outlets that extend from an existing outlet box that is not connected to an equipment grounding conductor. Once you add a receptacle outlet (branch-circuit extension), the receptacle must be of the grounding type — and it must have its grounding terminal connected to an equipment grounding conductor of a type recognized in 250.118, in accordance with 250.130(C).

All questions and answers are based on the 2008 NEC, taken from EC&M (http://ecmweb.com/nec/code_qa/)



HAPPY THANKSGIVING

We will be closed Thursday, November 25 and Friday, November 26 for the Thanksgiving holiday. Please plan accordingly.

Price Increases

- ◆ 10/1/10
SPEMCO
- ◆ INTERMATIC
11/1/10
- ◆ RELIANCE
11/1/10
- ◆ JUNO
11/1/10
- ◆ CANTEX PVC FITTINGS
1/3/11



*Good luck to all the
hunters... be safe!*

November Klein Tools Special Buys....

32500 — 11-in-1 Screwdriver
\$12.75 ea



D2000-9NETP—9" Lineman's Pliers
with fish tape puller

\$32.15 ea

RENTALS

Equipment:

- ◆ Mini-Tower Scaffolding
- ◆ 22' Scissors Lift
- ◆ Tractor/ Loader
- ◆ 3-Point Disc/ Cultivator
- ◆ 3-Point 48" Brush Mower
- ◆ Tandem Axle Trailer
- ◆ Mini Excavator
- ◆ Skid Steer
- ◆ Much more.....



Daily, weekly, and monthly rate lists are available at the sales counter or online .

THE HUTT ELECTRIC TEAM

Rick Ewert (ext.13)
President, Purchasing, Sales
Kathy Ewert (ext.16)
Office Manager,
Accts. Receivable/Payable
Mike Scarpaci (ext.11)
Inside Sales and Quotes
Brian Feit (ext.14)
Outside Sales South
Lee Schreiber (ext.19)
Sales, Warehouse, and
Inventory Control
Gerry Jochimsen (ext.21)
Sales and Warehouse
Allison Luedtke (ext.15)
Office Administration Asst.
Bill Stone
Delivery
Don Westphal
Delivery

HUTT ELECTRIC SUPPLY

1200 East Ash Street
PO Box 40
Abbotsford, WI 54405
Phone: 715-223-3651
Fax: 715-223-6398
Monday-Friday
7:00 a.m.- 4:30 p.m.

Visit us online!
www.hutt-online.com

